Air conditioning unit with asymmetrical high-capacity heat exchanger and integrated output-regulated heat pump and efficient volume flow control for medium-sized and large public swimming pool halls



At a glance:

- Dehumidifies, ventilates and heats
- Corrosion-free heat exchanger made from polypropylene
- Integrated output-regulated heat pump
- Average heating capacity value COP up to 7.2
- Energy-saving EC fans/EffiVent
- Demand-oriented volume flow rate reduction for supply and return air
- Two-stage supply air filtration
- Precise measurement and regulation of the outside air volume
- Fulfils the requirements of VDI 6022

Devices of the series 39 achieve a very high energy efficiency, since the integrated program only adds as much air as is required for dehumidification of the pool hall air. The overall efficiency of the system is further enhanced by the integrated heat pump. Due to the structural design of the unit the clean-ability according to VDI 6022 is ensured.

Further performance parameters and options:

- Modular design with high variability
- Filtering the air in any operating mode
- Pumped hot water air heater
- Individually controllable performance parameters
- Complete unit, ready to connect, contains all structural elements for air conditioning swimming pool hall air, including all control and regulation fittings
- Thermal bridge factor TB1
- Intensive quality inspection with factory test run

Options


- Pool water condenser
- HRC bypass function
- Dehumidification in recirculation mode
- Dehumidifying the outside air using additional outside and exhaust air connection pieces
- Reinforced compressor refrigeration system
- Fresh water heater
- Attenuator
- Outdoor installation
- Remote maintenance
- And many more






Standby mode

If no requirements are specified regarding temperature regulation or dehumidification when the swimming pool hall is in standby mode, the system operates only in recirculation mode. The air circulation in the swimming pool hall is guaranteed, with the fans working at a lower capacity.



Recirculation Air Operation (heating)


The pumped hot water heating coil heats the swimming pool hall as required in recirculation mode. In order to reduce the internal pressure losses, the recirculation air defrost damper is also opened. The outside air and exhaust air dampers are closed.



Swimming pool mode with dehumidification requirements

Return air is cooled and dehumidified in the evaporator of the continuously adjustable heat pump, reinforced by the upstream heat exchanger. The outside air, with its low moisture content, is preheated in the heat exchanger, and is subsequently mixed with a proportion of untreated recirculated air, heated in the condenser using the heat energy from the dehumidification process, and fed into the swimming pool hall as supply air. If the heating capacity is not sufficient, the supply air is reheated with the heating


coil. The use of the freely controllable heat pump allows the demand-oriented regulation of the volume flow rate. This guarantees a consistent humidity level in the swimming pool hall while consuming minimal energy. For hygiene reasons, a minimum of outside air is fed into the swimming pool hall during swimming pool mode. The proportion of outside air is determined based on the current evaporation of water (and therefore the occupancy level of the swimming pool hall) and is continuously adjusted.



Outside Air Exhaust Air Mode

In the case of rising outside air humidity, the recirculation air damper is continuously closing as required. If the outside air moisture is high, the damper closes completely, the system works exclusively in outside air-exhaust air mode via the


heat exchanger. The demand-oriented flow rate control reduces energy consumption to a minimum.



Optionally


In order to achieve the hall humidity levels required by VDI 2089 in summertime conditions, it may be necessary and more economical to use an additional damper system. A second outside air duct is used to take in outside air. Some of the outside air is precooled via the recuperator, and then cooled below dew point in the evaporator. The air is

then reheated in the recuperator, and then dried and cooled with some of the untreated outside air, before being introduced into the hall as supply air. If no heating of the swimming pool hall is required, the heat of condensation is discharged directly into the return air flow.



ThermoCond Type 39

System dimensions and weights

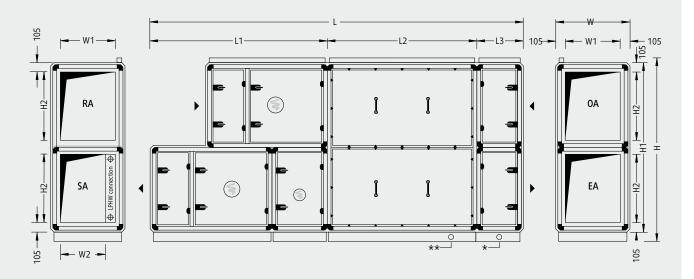

Important! Where a system is operated in parallel, the supply air and return air ducts of the two units have to be brought together.

Where units are run in parallel, each unit has a controls cabinet.

Mirror-image design possible.

- * Floor drain
- ** Condensate drain

Unit type	L1	W ²	H ³	L11	L21	L31	W1	W2	H1	H2	Weight ¹
39 03 01	3,940	790	1,700	1,970	1,370	600	580	510	1,520	580	1,050
39 05 01	4,100	1,110	1,700	2,130	1,370	600	900	830	1,520	580	1,300
39 06 01	4,740	790	2,340	2,130	2,010	600	580	420	2,160	900	1,350
39 10 01	4,740	1,110	2,340	2,130	2,010	600	900	740	2,160	900	1,650
39 13 01	4,900	1,430	2,340	2,290	2,010	600	1,220	1,060	2,160	900	2,050
39 16 01	4,900	1,750	2,340	2,290	2,010	600	1,540	1,380	2,160	900	2,250
39 19 01	4,900	2,070	2,340	2,290	2,010	600	1,860	1,700	2,160	900	2,500
39 25 01	5,700	2,070	2,980	2,450	2,650	600	1,860	1,700	2,800	1,220	3,250
39 32 01	6,180	2,070	3,620	2,450	3,130	600	1,860	1,700	3,440	1,540	3,950
39 36 01	6,180	2,390	3,620	2,450	3,130	600	2,180	2,020	3,440	1,540	4,650

Largest transport unit

Unit Type	L¹	W	H³	Weight ¹
39 03 01	1,970	790	1,700	510
39 05 01	2,130	1,110	1,700	660
39 06 01	2,130	790	2,340	630
39 10 01	2,130	1,110	2,340	750
39 13 01	2,290	1,430	2,340	980
39 16 01	2,290	1,750	2,340	1,130
39 19 01	2,290	2,070	2,340	1,270
39 25 01	2,650	2,070	2,980	1,210
39 32 01	3,130	2,070	3,620	1,700
39 36 01	3,130	2,390	3,620	2,050

Controls cabinet

Unit Type	H x W x D ¹	Position at unit
39 03 01	1,120 x 640 x 210	SA/RA side
39 05 01	1,120 x 640 x 210	SA/RA side
39 06 01	1,280 x 640 x 210	SA/RA side
39 10 01	1,280 x 640 x 210	SA/RA side
39 13 01	1,280 x 640 x 210	SA/RA side
39 16 01	1,280 x 640 x 210	SA/RA side
39 19 01	1,280 x 640 x 210	SA/RA side
39 25 01	1,280 x 640 x 210	SA/RA side
39 32 01	1,600 x 640 x 250	SA/RA side
39 36 01	1,600 x 640 x 250	SA/RA side

For service work, a clearance corresponding to dimension W is required on the operating side of the unit. If dimension W is smaller than one metre, please leave a clearance of one metre. For service work above the unit, please allow 50 mm working height clearance above the cable duct.

Please comply with the dimensions for body size, air duct connections and electrical controls cabinet.

All lengths are given in mm, weights in kg, weight incl. controls cabinet.

- 1 May change depending
- on choosen option

 Door fitting assembly increase unit width by 65 mm each operating side
- operating side 2 incl. 120 mm base frame, incl. 60 mm cable duct

3 transportation units are supplied, including controls cabinet. Further partitioning for smaller apertures possible (at extra cost).



Technical specifications and services

Unit Type		39 03 01	39 05 01	39 06 01	39 10 01	39 13 01	39 16 01		
Optimum flow rate	m³/h	2,600	3,900	4,000	6,000	7,900	9,800		
Max. volume flow rate ¹	m³/h	3,500	5,300	6,300	9,500	12,600	15,800		
Heat recovery efficiency ²	%	83	83	83	83	84	84		
Heat recovery efficiency acc. EN 308	%	53	53	63	63	63	63		
Dehumidification capacity according to VDI 2089 Vopt	kg/h	17.1	25.2	25.8	38.8	51.0	63.3		
Dehumidification capacity according to VDI 2089 V _{max} ¹	kg/h	22.6	34.2	40.7	61.4	81.4	102.1		
Heating capacity of heat pump	COP	6.0	7.5	7.4	6.8	7.0	7.1		
Total electrical power rating ³	kW	4.2	3.5	3.4	5.3	7.0	7.9		
Max. current consumption ³	A	12.1	12.1	12.1	20.2	29.6	30.5		
Operating voltage	,,	12.1	12.1		400 V 50 Hz	27.0	30.3		
Ext. pressure losses		3 / W / TE 700 V 30 HZ							
Supply and fresh air channel	Pa	300	300	300	300	300	300		
Return and exhaust air channel	Pa	300	300	300	300	300	300		
Sound power level ⁴	10	300	300	300	300	300	300		
Supply air vent	dB(A)	78	67	66	71	75	70		
RA connection	dB(A)	71	64	65	72	67	68		
Outside air vent	dB(A)	68	59	59	65	65	64		
EA connection	dB(A)	71	62	62	69	65	66		
Acoustic pressure at a distance of 1 m from the device ⁴	dB(A)	63	53	52	58	60	56		
Fan units	()			-					
Rated motor input for supply air (100% 60% volume flow rate) 5	kW	1071068	1391082	1391081	2.16 1.14	2611157	3.12 1.76		
Rated motor input for return air (100% 60% volume flow rate) 5	kW	0.78 0.51		1.11 0.62	-	-	2.49 1.37		
SFP category supply air return air (60% V _{opt})		2 2	1 2	1 2	1 2	1 1	1 2		
Nominal rating supply air return air	kW	1.7 1.7	1.7 1.7	1.7 1.7	3.0 3.0	4.7 4.7	4.7 4.7		
Integrated heat pump		'	'	'	'	'	'		
Filling volume refrigerant type R407C (without PWC with PWC)	kg	4.0 5.0	5.0 6.0	6.0 6.0	7.0 9.0	10.0 11.0	12.0 14.0		
Rated compressor input for OA operation (60% V _{opt})	kW	2.3	2.0	2.0	3.3	4.3	4.8		
Heating capacity of heat pump for OA operation (60% Vopt)	kW	13.9	15.0	14.7	22.5	30.0	34.1		
Efficiency classes according to EN 13053:2012									
Heat recovery class		H1	H1	H1	H1	H1	H1		
Power consumption of fan motors SA RA		P2 P2	P1 P1	P1 P1	P3 P3	P1 P1	P1 P1		
Air velocity class		V1	V1	V2	V2	V2	V2		
Filtration according to DIN EN 779									
Supply air Outside air				F7	M5				
Return air				N	15				
LPHW									
Max. heating power ⁶	kW	14.9	22.8	23.2	35.2	54.0	63.7		
Water flow rate and pressure losses									
LPHW	m³/h kPa	0.85 5.2	1.39 3.6	1.28 4.3	2.23 3.8	2.36 5.1	3.31 4.4		
LPHW valve	m³/h kPa	0.85 11.5			2.23 5.0	2.36 5.6	3.31 7.0		
Pool water condenser 7,8									
Heating capacity	kW	14.1	15.0	14.6	22.2	29.4	33.0		
Spread of pool water temperature	K	8.1	8.1	7.8	8.0	8.2	7.5		
Pool water volume flow rate	m³/h	1.5	1.6	1.6	2.4	3.1	3.8		
Water side pressure loss	kPa	6.0	6.8	6.8	6.7	10.9	16.1		
Connections									
LPHW connection	DN	32	32	32	32	40	40		
LPHW control valve connection	DN	15	20	20	25	25	32		
Condensate drainage	DN	40	40	40	40	40	40		
Floor drain	DN	20 40	20 40	20 40	20 40	20 40	20 40		
PWC connection ⁷	DN	25	25	25	40	40	40		
						. •			

Specifications of technical data relate to the optimum flow rate and return air condition 30° C / 54% r.h., outside air condition 15° C / 84% r.h. and standard density (1.204 kg/m³), unless otherwise specified.

- 1 May require alteration of the technical equipment 2 RA = 30° C / 54% r.h.; OA = -12° C / 90% r.h.; 1/3 OA rate
- 3 Depends on configuration of measurement and control
- system/unit 4 at 250 Hz mid-band frequency

- 4 at 250 RE inhoration therefore the equency
 5 with average filter contamination
 6 FL = 70° C; SA ≈ 50° C
 7 Pool water condenser (supplementary equipment)
 8 Heat emission full and proportional; when water enters 28° C

Please seek approval of technical data and specifications prior to start of the planning process.



Technical specifications and services

Unit Type		39 19 01	39 25 01	39 32 01	39 36 01	
Optimum flow rate	m³/h	11,800	15,800	19,900	23,100	
Max. volume flow rate ¹	m³/h	19,000	25,000	30,000	33,500	
Heat recovery efficiency ²	%	84	84	84	84	
Heat recovery efficiency acc. EN 308	%	63	65	64	64	
Dehumidification capacity according to VDI 2089 Vopt	kg/h	76.2	102.1	128.6	149.2	
Dehumidification capacity according to VDI 2089 V _{max} ¹	kg/h	122.7	161.5	193.8	216.4	
Heating capacity of heat pump	COP	7.0	7.2	7.4	7.3	
Total electrical power rating ³	kW	11.2	14.0	17.0	19.8	
Max. current consumption ³	А	36.1	54.7	61.4	75.3	
Operating voltage				100 V 50 Hz		
Ext. pressure losses						
Supply and fresh air channel	Pa	400	400	500	500	
Return and exhaust air channel	Pa	400	400	500	500	
Sound power level ⁴				ı	l	
Supply air vent	dB(A)	75	82	77	78	
RA connection	dB(A)	73	71	75	75	
Outside air vent	dB(A)	69	71	73	79	
EA connection	dB(A)	70	71	72	73	
Acoustic pressure at a distance of 1 m from the device 4	dB(A)	60	67	62	70	
Fan units	` '					
Rated motor input for supply air (100% 60% volume flow rate) 5	kW	4.66 2.60	6.02 3.78	8.66 4.84	9.96 6.18	
Rated motor input for return air (100% 60% volume flow rate) 5	kW	3.66 1.90	4.98 2.92	7.02 3.96	8.24 2.22	
SFP category supply air return air (60% V _{opt})		2 2	2 2	3 3	2 3	
Nominal rating supply air return air	kW	6.0 4.7	9.4 9.4	11.0 9.4	16.5 9.4	
Integrated heat pump						
Filling volume refrigerant type R407C (without PWC with PWC)	kg	16.0 20.0	23.0 25.0	29.0 31.0	31.0 35.0	
Rated compressor input for OA operation (60% Vopt)	kW	6.7	7.3	8.2	11.4	
Heating capacity of heat pump for OA operation (60% Vopt)	kW	46.8	52.4	60.7	83.1	
Efficiency classes according to EN 13053:2012						
Heat recovery class		H1	H1	H1	H1	
Power consumption of fan motors SA RA		P3 P2	P3 P2	P3 P1	P3 P2	
Air velocity class		V2	V2	V2	V2	
Flitration according to DIN EN 779						
Supply air Outside air			F7	M5		
Return air			M5			
LPHW						
Max. heating capacity ⁶	kW	81.9	103.0	127.7	158.7	
Water flow rate and pressure losses						
LPHW 8	m³/h kPa	3.58 5.7	5.63 3.2	7.25 2.9	7.38 3.3	
LPHW valve ⁸	m³/h kPa	3.58 8.2	5.63 5.1	7.25 3.3	7.38 3.4	
Pool water condenser 7,8						
Heating capacity	kW	48.6	53.2	60.1	84.5	
Spread of pool water temperature	K	8.5	8.3	8.3	8.5	
Pool water volume flow rate	m³/h	4.9	5.5	6.2	8.6	
Water side pressure loss	kPa	8.6	10.7	13.4	8.3	
Connections						
LPHW connection	DN	40	50	50	65	
LPHW control valve connection	DN	32	40	40	40	
Condensate drainage	DN	40	40	40	40	
Floor drain	DN	20 40	20 40	20 40	20 40	
PWC connection ⁷	DN	50	50	50	50	
Specifications of technical data relate to the optimum 3 Depends on confi					and specifications prior	

Specifications of technical data relate to the optimum flow rate and return air condition 30° C / 54% r.h., outside air condition 15° C / 84% r.h. and standard density (1.204 kg/m³), unless otherwise specified.

- May require alteration of the technical equipment RA = 30° C / 54% r.h.; OA = -12° C / 90% r.h.; 1/3 OA rate
- 3 Depends on configuration of measurement and control
- system/unit 4 at 250 Hz mid-band frequency

- 4 at 250 Hz information requestry
 5 with average filter contamination
 6 FL = 70° C, SA ≈ 50° C
 7 Pool water condenser (supplementary equipment)
 8 Heat emission full and proportional; when water
 - enters 28° C

Please seek approval of technical data and specifications prior to start of the planning process.

